

## TECHNICAL MEMORANDUM

---

**To:** Ian McAllister, Ashleigh Crompton, Mike Champion,  
Jackie Boruch and Ryan Schucroft (Woodfibre LNG) **Date:** 26 July 2024

**From:** Cheng Kuang, Holly Pelletier and Patrick Mueller  
(Lorax) **Project #:** A633-7

**Subject:** PE-111578 Weekly Discharge and Compliance Report #23 for July 14 – 20

---

Waste Discharge Authorization Effluent Permit PE-111578 was issued by the British Columbia Energy Regulator (BCER) to Woodfibre LNG on February 9, 2024. The permit specifies monitoring and reporting requirements that are required to be met by Woodfibre LNG during construction of the LNG Export Facility. Reporting is required on a weekly basis.

Discharge and compliance monitoring is conducted by on-site Environmental Monitors (Roe Environmental) that are sub-contracted to the civil works contractor (LB LNG). Analytical samples are submitted by Roe Environmental to ALS Environmental in Burnaby, BC, for testing. Lorax Environmental provides water quality database management and WDA compliance reporting services for Woodfibre LNG.

This technical memorandum (Report #23) was prepared by Lorax Environmental and summarizes monitoring conducted the week of July 14 – 20 for contact waters directed to a WWTP or a sedimentation pond. Monitoring data and pending results from prior reporting periods available at the time of reporting are tabulated and included as appendices. Report #23 has been prepared to meet the requirements specified in Condition 4.2 of WDA Effluent Permit PE-111578:

“The Permittee shall summarize the results of the discharge and compliance monitoring program in a report that shall be submitted to the BCER weekly over the term of this permit. Reports must include suitable tabulated data. The table must include any applicable regulatory limits/guidelines *e.g.* permit limits, BC Water Quality Guidelines etc. Any exceedances of respective regulatory limits/guidelines must be clearly highlighted. Any missed sampling events/missing data must be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to [Waste.Management@bc-er.ca](mailto:Waste.Management@bc-er.ca). A copy of the reports shall be provided to each First Nation consulted with regarding this subject permit, and also made publicly available on the Woodfibre LNG Environmental Reporting webpage.”

The site layout is shown in Figure 1 at the end of this report. Sedimentation pond photographs are included in Appendix A, and monitoring results are tabulated in Appendix B and Appendix C for contact water samples.

## 1. Current Conditions

The Construction Phase of the Woodfibre LNG Export Facility commenced in October 2023. Early stage civil works are ongoing, and these include site grading, levelling, bedrock excavation and sedimentation pond and WWTP construction. Shoring works along the shoreline and foreshore areas were initiated in December 2023, and in early 2024 construction of water management infrastructure was initiated and has continued through the July 14 – 20 monitoring period. The East WWTP is constructed and operating, and the East Sedimentation Pond has been commissioned for discharge. The PE- 111578 water management facilities that are completed or were under construction during the reporting period are shown in Figure 1.

The East and West catchments contact water conveyance ditches described in PE-111578 were designed to transport non-contaminated contact water to the East and West sedimentation ponds and will be constructed following completion of site preparation activities (*e.g.*, site grading, bedrock excavation) along the ditch lines. Until the ditches are operational, non-contaminated contact waters are managed to remain on site or are directed by pumping to the East Sedimentation Pond or East WWTP. Contaminated contact waters are contained and directed to the East WWTP.

A revised schedule is being developed to complete the installation of the East Sedimentation Pond permanent outfall structure. Until the outfall is constructed, a temporary discharge system (*i.e.*, pump, hosing and diffusor) is used to convey East Sedimentation Pond effluent to the authorized discharge location when necessary for the discharge of excess water, and if the effluent water quality meets the requirements set out in PE-111578.

The West Sedimentation Pond is complete, except for the outfall structure, and has not been commissioned for discharge. However, the pond has been used to store contact water that is subsequently directed to the East WWTP for treatment. The schedule for completion of the pond outfall structure is being revised. The West WWTP has been partially assembled and commissioning of the WWTP is planned for late July or early August with the commencement of pilot trials.

The completed non-contact water diversion ditch west of Mill Creek was commissioned for use on April 7 and discharges to Mill Creek at station OUT-06 (Figure 1). Monitoring stations OUT-01, OUT-02, and OUT-11 at pre-existing culvert outlets have been established noting that the outlets will be upgraded and extended later in the construction schedule. Additional construction is underway for diversion ditching leading to stations OUT-02 and OUT-11.

Pilot testing of the East WWTP continued during the monitoring period (July 14 – 20). Contaminated and potentially contaminated contact waters from baker tanks located near the East Sedimentation Pond were directed to the East WWTP for treatment, as well as water recirculated from the East Sedimentation Pond. The contact water source areas are shown in Figure 2 and

Figure 3 in Appendix A. A total of 4,037 m<sup>3</sup> of treated WWTP effluent was discharged to the East Sedimentation Pond during the reporting period (July 14 – 20). Daily WWTP effluent flows are provided in Appendix C (Table C-2).

A total of 1,999 m<sup>3</sup> of effluent was discharged from the East Sedimentation Pond to Howe Sound intermittently on July 18, 19, and 20. There were no discharges from the East and West Sedimentation Ponds from July 14 – 17. Daily effluent flows are provided in Appendix B (Table B-3). Photographs of the ponds are included in Appendix A (Figure 4 and Figure 5).

The weather was warm and sunny during the monitoring period (July 14 – 20). Daily Temperature and precipitation records were not available at the local Woodfibre Weather Station due to ongoing station outage. The weather station will be repaired; however, it is uncertain when the station will be back to normal operation. In the interim, weather data were obtained from the Main Street Squamish Station. The daily weather conditions are summarized in Table 1.

**Table 1:  
Summary of Certified Project Area (CPA) Daily Weather Conditions.**

Date	Precipitation (mm)	Max. Temp (°C)	Min. Temp (°C)	Weather Description
07-14-2024	0	25.7	13.9	Sun
07-15-2024	0	23.2	13.8	Sun
07-16-2024	0	26.7	14.5	Sun
07-17-2024	0	29.5	16.0	Sun
07-18-2024	0	26.5	16.4	Sun
07-19-2024	0	25.6	15.5	Sun
07-20-2024	0	28.0	14.6	Sun

Note: Data retrieved from the Main Street Squamish Station due to ongoing outage of the Woodfibre Weather Station.

## 2. Monitoring Summary

The PE-111578 authorized works were under construction during the July 14 – 20 monitoring period. Compliance monitoring stations are progressively established as water management infrastructure is completed. Monitoring is conducted by the on-site Environmental Monitors (Roe Environmental). Analytical samples are submitted by Roe Environmental to ALS Environmental in Burnaby, BC, for testing.

The following monitoring stations have been established (Figure 1):

- Creek water (SW-01, SW-02, SW-03, SW-04, SW-07).
- Howe Sound reference and IDZ locations (WQR1, WQR2, IDZ-E1 and IDZ-E2).

- Non-contact diversion ditch outlets (OUT-01, OUT-02, OUT-06, and OUT-11).
- Contact water monitoring locations (WWTP-E-IN, WWTP-E-OUT, SP-E-IN-2, SP-E-OUT, SP-E-NE, and SP-E-NW).

East Sedimentation Pond influent and effluent stations SP-E-NW and SP-E-NE, respectively, are in-pond stations that may be monitored in place of stations SP-E-IN-2 and SP-E-OUT when there is no influent to, or discharge from the East Sedimentation Pond.

Stations IDZ-E1, IDZ-E2, WQR1, WQR2, WWTP-E-IN, WWTP-E-OUT, SP-E-NW, SP-E-NE, and SP-E-OUT were monitored during the monitoring period (July 14 – 20). Sampling dates and parameters tested are summarized in Table 2.

Overall, the PE-111578 monitoring requirements that were applicable during the monitoring period (July 14 – 20) were met. Field parameters and analytical samples were not collected at the influent station SP-E-IN-2 as the pond did not receive contact water inflows.

**Table 2:  
Summary of PE-111578 Monitoring Samples Collected July 14 – 20.**

Sampling Date	Sample	Description	Parameters Tested	Monitoring Frequency
July 14, 2024	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field & Physical Parameters, EPHs & PAHs, Total, Dissolved and Speciated Metals.	D, W <sub>1</sub> , P
	SP-E-NW <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents influent quality		
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
July 15, 2024	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field Parameters.	D
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
July 16, 2024	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field, Physical & General Parameters, VH & BTEX, EPHs & PAHs, Total, Dissolved and Speciated Metals, VOCs, Dioxins and Furans.	D, W <sub>1</sub> , W <sub>2</sub> , P
	SP-E-NW <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents influent quality		
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
July 17, 2024	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field Parameters.	D
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
	IDZ-E1-0.5	Howe Sound IDZ station E1; 0.5 m below surface	Field and Physical Parameters	P
	IDZ-E1-2m	Howe Sound IDZ station E1; 2 m below surface		
	IDZ-E1-SF	Howe Sound IDZ station E1; 2 m above the seafloor		
	IDZ-E2-0.5	Howe Sound IDZ station E2; 0.5 m below surface		
	IDZ-E2-2m	Howe Sound IDZ station E2; 2 m below surface		
IDZ-E2-SF	Howe Sound IDZ station E2; 2 m above the seafloor			
July 18, 2024	SP-E-OUT	East Sedimentation Pond effluent (compliance point)	Field, Physical & General Parameters, VH & BTEX, EPHs & PAHs, Total, Dissolved and Speciated Metals, VOCs, Methylmercury, Dioxins and Furans.	D, W <sub>1</sub> , W <sub>2</sub>
	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field Parameters.	D
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
July 19, 2024	SP-E-OUT	East Sedimentation Pond effluent (compliance point)	Field Parameters.	D
	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality		
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
	IDZ-E1-0.5	Howe Sound IDZ station E1; 0.5 m below surface	Field, Physical & General Parameters, VH & BTEX, EPHs & PAHs, Total, Dissolved and Speciated Metals, VOCs, Methylmercury, Dioxins and Furans.	W <sub>3</sub>
	IDZ-E1-2m	Howe Sound IDZ station E1; 2 m below surface		
	IDZ-E1-SF	Howe Sound IDZ station E1; 2 m above the seafloor		
	IDZ-E2-0.5	Howe Sound IDZ station E2; 0.5 m below surface		
IDZ-E2-2m	Howe Sound IDZ station E2; 2 m below surface			
IDZ-E2-SF	Howe Sound IDZ station E2; 2 m above the seafloor			
July 20, 2024	SP-E-NE <sup>1</sup>	East Sedimentation Pond, in-pond sample, represents effluent quality	Field Parameters.	D
	WWTP-E-OUT	East WWTP effluent		
	WWTP-E-IN	East WWTP influent		
	WQR1-0.5	Reference site 1; 0.5 m below surface.	Field, Physical & General Parameters, VH & BTEX, EPHs & PAHs, Total, Dissolved and Speciated Metals, VOCs, and Methylmercury.	M
	WQR1-2m	Reference site 1; 2 m below surface.		
	WQR1-SF	Reference site 1; 2 m above the seafloor.		
	WQR2-0.5	Reference site 2; 0.5 m below surface.		
	WQR2-2m	Reference site 2; 2 m below surface.		
WQR2-SF	Reference site 2; 2 m above the seafloor.			

**Notes:**

Monitoring frequency requirements under PE-111578 are indicated as follows:

D – daily monitoring of field parameters at WWTP and sedimentation pond influent and effluent stations.

M – Monthly monitoring for all parameters at WWTP, sedimentation pond and receiving environment stations.

W<sub>1</sub> – initial high frequency monitoring for physical parameters at WWTP and sedimentation pond influent and effluent stations (weekly for the first 6 months of monitoring).W<sub>2</sub> – initial high frequency monitoring for all parameters at WWTP and sedimentation pond influent and effluent stations (weekly for the first 5 weeks of monitoring).W<sub>3</sub> – initial high frequency monitoring for physical parameters at IDZ stations (weekly for the first 5 weeks of monitoring).

P – periodic monitoring for targeted parameters that is supplementary to PE-111578 requirements.

<sup>1</sup> In-Pond stations SP-E-NW and SP-E-NE may be monitored in place of stations SP-E-IN-2 and SP-E-OUT, respectively, when there is no influent to, or discharge from the East Sedimentation Pond at the time of monitoring.

### 3. Water Quality Results

#### 3.1 Screening and Reporting Overview

Water quality and flow monitoring results are screened against field quality control (QC) criteria, benchmark values and PE-111578 discharge limits. The screening results are discussed in the following sections and items outside the screening criteria are also summarized in the Section 4 tracking table (Table 6).

All water quality results are stored in the Woodfibre LNG environmental monitoring database. However, for brevity, a sub-set of the results are presented in the weekly report appendices. Results are reported for parameters with a freshwater, estuarine or marine water quality guideline for the protection of aquatic life, parameters with a discharge limit, parameters of potential concern (*i.e.*, dioxins and furans), as well as other parameters that are relevant for water quality characterization.

Federal and Provincial Water Quality Guidelines (WQG) are not specified for dioxins and furans. The general term “dioxins and furans” refers to a grouping of hundreds of individual compounds with similar chemical composition and properties. To simplify result presentation and interpretation, the results of individual compounds are converted to a total toxic equivalent (TEQ) value and are summed to produce single TEQ values for each sample by the laboratory. Consistent with the pre-construction baseline monitoring program, a lower-bound TEQ value is reported. The lower-bound TEQ is calculated assuming a concentration of zero for results reported as not detected, therefore, if individual compounds are not detected the TEQ will equal zero.

#### 3.2 Summary of Reported Results

Field measurements and analytical results available at the time of reporting for samples collected during the monitoring period (July 14 – 20) and for other samples that have not been previously reported are listed below in Table 3. Analytical results not available at the time of reporting will be included in future weekly reports when available for the following samples:

- IDZ-E1 and IDZ-E2 samples collected July 17 (only field results available)
- IDZ-E1 and IDZ-E2 samples collected July 19 (only field results available)
- WQR1 and WQR2 samples collected July 20 (only field results available)

Analytical results for methylmercury, dioxins and furans were not reported for the following samples and will be included in future weekly reports when available (these tests typically require up to 4 weeks to complete):

- SP-E-NE and SP-E-NW collected July 16 (dioxins and furans)
- SP-E-OUT collected July 18 (methylmercury, dioxins and furans)

**Table 3:**  
**Summary of Analytical Results Included in Weekly Discharge and Compliance Report #23.**

Sample	Description	Sampling Date	Parameters Reported
SP-E-NE	East Sedimentation Pond, in-pond sample, represents effluent quality	July 14, 2024	Field and Physical Parameters, Total and Dissolved Metals, Hexavalent Chromium, and PAHs.
SP-E-NW	East Sedimentation Pond, in-pond sample, represents influent quality		
WWTP-E-OUT	East WWTP effluent		
WWTP-E-IN	East WWTP influent		
SP-E-NE	East Sedimentation Pond, in-pond sample, represents effluent quality	July 16, 2024	Field, Physical and General Parameters, Total and Dissolved Metals, Hexavalent Chromium, PAHs, and VOCs.
SP-E-NW	East Sedimentation Pond, in-pond sample, represents influent quality		
WWTP-E-OUT	East WWTP effluent		
WWTP-E-IN	East WWTP influent		
SP-E-OUT	East Sedimentation Pond effluent (compliance point)	July 18, 2024	Field, Physical and General Parameters, Total and Dissolved Metals, Hexavalent Chromium, PAHs, and VOCs.

### 3.3 East Sedimentation Pond

The East Sedimentation Pond influent and effluent results are screened against PE-111578 discharge limits. Parameters without a discharge limit are screened against BC, Canadian and Federal water quality guidelines (WQGs) for the protection of marine water aquatic life. Influent water is not discharged from site, therefore only effluent water quality is assessed for exceedances. The analytical results, daily field parameters, discharge limits and WQGs are summarized in Table B-1 (analytical results) and Table B-2 (field measurements) of Appendix B.

During the monitoring period (July 14 – 20), the East Sedimentation Pond received East WWTP treated effluent each day. The sedimentation pond did not receive contact water during the monitoring period; therefore, field measurements and analytical samples at station SP-E-IN-2 were not collected. Field measurements were taken daily at the in-pond effluent quality station (SP-E-NE), and twice at the in-pond influent quality station (SP-E-NW). Analytical samples were collected at stations SP-E-NE and SP-E-NW on July 14 and 16.

Field measurements and analytical results for the in-pond samples met PE-111578 discharge limits during the monitoring period (July 14 – 20). Daily dissolved oxygen concentrations monitored at

stations SP-E-NE and SP-E-OUT ranged from 4.75 to 7.97 mg/L, which were lower than the WQG ( $\geq 8.0$  mg/L). The July 19 dissolved oxygen reading was erroneous and not reported.

The East Sedimentation Pond was intermittently dewatered on July 18, 19, and 20 by pumping effluent to the discharge location SP-E-OUT. Effluent sample SP-E-OUT was collected on July 18 while the pond was discharging. Field measurements and analytical results for the July 18 effluent sample met PE-111578 discharge limits.

Field measurements of dissolved oxygen collected at SP-E-OUT on July 18 and 19 (4.75 and 6.48 mg/L, respectively) did not meet the WQG ( $\geq 8$  mg/L; Table 4). The mixing zone model indicates the effluent dissolved oxygen would meet the WQG within the initial mixing zone (IDZ) defined in PE-111578.

**Table 4:**  
**Summary of WQG Exceedances for the East Sedimentation Pond at Effluent Station SP-E-OUT.**

Parameter	Units	WQG (LT)	N	N >WQG	Commentary
Dissolved Oxygen	mg/L	$\geq 8.0$	2	2	The field measurement of dissolved oxygen at the effluent station (SP-E-OUT) on July 18 (4.75 mg/L) and July 19 (6.48 mg/L) were below the lower limit of the WQG. The mixing zone model indicates the dissolved concentration would be raised above the lower limit of the WQG within the initial dilution zone defined in PE-111578. The root cause of the low dissolved oxygen concentrations is under investigation and is being tracked in Section 4 (Table 6) of this report.

WQG = British Columbia or Canadian Water Quality Guideline for the Protection of Aquatic Life. LT = long-term freshwater or estuarine aquatic life guideline. Variable dependant guidelines were calculated for each sample using sample specific parameter values. The nearest boundary value was used if a variable was outside the formula range.

N = number of samples.

Non-detect results are screened using the detection limit value.

### 3.4 East Wastewater Treatment Plant

The East WWTP influent and effluent results are screened against the minimum discharge objectives (MDOs) which the WWTP was designed to meet. Contaminated contact water is directed to the WWTP influent, and it is expected that influent water is unlikely to meet MDOs, therefore only effluent water quality is assessed for exceedances. The analytical results, daily field measurements, and MDOs are summarized in Table C-1 (analytical results) and Table C-2 (field measurements) of Appendix C. Screening results are summarized in Table 5 for parameter concentrations that do not meet MDOs.

The East WWTP received contact water and recirculated East Sedimentation Pond water each day July 14 – 20 (Section 2). The influent waters were treated by the East WWTP and discharged to the East Sedimentation Pond. Field measurements were collected each day at the influent and effluent stations, WWTP-E-IN and WWTP-E-OUT, respectively. Field pH ranged from 6.6 to 7.2



at WWTP-E-IN during the monitoring period (July 14 – 20), while dissolved oxygen ranged from 5.53 to 7.45 mg/L, and turbidity ranged from 0.72 to 6.38 NTU (Appendix C, Table C-2). Field pH, dissolved oxygen, and turbidity in the East WWTP effluent (WWTP-E-OUT) ranged from 5.8 to 6.4 pH unit, 3.41 to 6.3 mg/L, and 0 to 4.91 NTU, respectively.

Field measurements for pH and dissolved oxygen did not meet the MDOs in all WWTP-E-OUT samples collected during the monitoring period. Pilot testing of the East WWTP is underway and the deviations in pH are attributed to WWTP process adjustments during the monitoring period. Although deviations from MDOs are expected to occasionally occur during the East WWTP pilot trial, due to the increasing frequency of low dissolved oxygen values an investigation is underway to identify root cause and potential mitigations for low oxygen concentrations (Table 5).

Analytical samples were collected from East WWTP influent and effluent stations on July 14 and 16. Effluent quality monitored at WWTP-E-OUT met MDOs for all parameters except for total vanadium in both samples (Table 5).

**Table 5:  
Summary of MDO Exceedances for the East WWTP at Effluent Station WWTP-E-OUT.**

Parameter	Units	MDO	N	N >MDO	Commentary
Field pH	s.u.	7.0-8.7	7	7	Field pH was below the lower limit of the MDO during the monitoring period (July 14 – 20). Process adjustments are underway and occasional deviations from MDOs may occur during the pilot period.
Field Dissolved Oxygen	mg/L	$\geq 8$	7	7	Field dissolved oxygen was below the lower limit of the MDO during the monitoring period (July 14 – 20). The root cause of the low dissolved oxygen concentrations is under investigation and is tracked in Section 4 (Table 6) of this report.
Total Vanadium	mg/L	0.005	2	2	The total vanadium concentrations were 1.16 and 1.17 times greater than the MDO in the July 14 (0.00582 mg/L) and July 16 (0.00583 mg/L) samples, respectively. Additional process adjustments are under development to improve the removal of vanadium.

MDO = Minimum discharge objective.

N = number of samples.

Non-detect results are screened using the detection limit value.

### 3.5 Non-Contact Water Diversion Ditch Outlets

There are no water quality results available for the non-contact water diversion ditch outlets at the time of reporting.

### 3.6 Freshwater and Estuarine Water Receiving Environment

There are no water quality results available for the freshwater and estuarine water receiving environment at the time of reporting.

### **3.7 Marine Water Receiving Environment**

There are no water quality results available for the marine water receiving environment at the time of reporting.

## **4. Quality Control**

This section presents the results of the quality control (QC) evaluation for the PE-111578 weekly report (Table 6). The evaluation includes a review of field and lab QC, completeness of the weekly report (*i.e.*, pending data), completeness of the monitoring program, confirmation of recordkeeping, evaluation of compliance and review of water management activities. Items flagged for follow-up in the exceedance tables in Section 3 are transferred to Table 6. Any items flagged for follow-up in Table 6 are carried forward to future reports until they are closed.

**Table 6:  
Weekly Report QC Evaluations and Ongoing Items**

QC Procedure	Observation	Investigation/Resolution
<b>Reporting Period (July 14 – 20, Report #23)</b>		
<b>Monitoring Program Evaluation</b>	PE-111578 contact water, non-contact water and initial dilution zone monitoring stations have not been fully established.	The PE-111578 authorized works were under construction during the reporting period. Monitoring stations are progressively established as water management infrastructure is completed. The East Sedimentation Pond and East WWTP are completed, and pilot testing of the East WWTP is ongoing. The East Sedimentation Pond was commissioned for discharge on April 15. The West Sedimentation Pond is complete, except the outfall structure and West WWTP is under construction. The West Sedimentation Pond is not commissioned for discharge and did not discharge. The non-contact water diversion ditch that discharges at station OUT-06 has been commissioned, and stations for pre-existing outfalls OUT-01, OUT-02, and OUT-11 have also been established.
<b>Pending Data</b>	Analytical results for samples collected July 17, 19, and 20 were not reported.	Analytical results for marine receiving environment samples collected July 17, 19, and 20 were not complete at the time of reporting. The pending results will be included in future weekly reports when available. This item remains open.
<b>Lab Data QC</b>	Dissolved zinc greater than total zinc concentration in the SP-E-OUT sample collected July 18.	The concentration of dissolved zinc (0.0144 mg/L) was greater than the concentration of total zinc (0.0099 mg/L) and above the total zinc discharge limit (0.0133 mg/L). Total zinc represents the concentration of dissolved and particle-bound zinc, therefore, by this definition, total zinc should be equal to or greater than the corresponding dissolved zinc concentration. Laboratory re-analysis verified the original reported results for dissolved and total zinc. The laboratory also tested the unpreserved water in the general parameters sample bottle and reported comparable total and dissolved zinc concentrations (0.0090 and 0.0089 mg/L, respectively) that are aligned with the originally reported total zinc concentration. Based on the lab investigation, the original dissolved zinc result of 0.0144 mg/L is inferred to be influenced by contamination of the dissolved metals bottle. Additional investigation is ongoing. This item remains open.
<b>Ongoing Items from Previous Weekly Reports</b>		
<b>Report #13: WWTP Performance Evaluation</b>	The May 6 monitoring results for East WWTP indicate dissolved vanadium was not being removed by the treatment process.	Sampling conducted since May 6 indicates vanadium in treated WWTP effluent is almost entirely in soluble form, suggesting this form of vanadium is only partially treated, resulting in residual vanadium concentrations in the treated effluent that are generally below, but often in the vicinity of the MDO concentration (0.005 mg/L). Process adjustments are underway to improve vanadium removal as part of the WWTP pilot trials. This item remains open.
<b>Report #17: Pending Data</b>	Methyl mercury, dioxin and furan results for samples collected June 3 – 4 and June 8 were not reported.	Available methylmercury results for the June 3 SP-E-OUT sample are discussed in Section 3.3 of Report #17. The same section in Report #18 includes the June 4 and June 8 methylmercury results. Dioxin and furan results for samples collected June 3 – 4, and June 8 were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in mid July. This item remains open.
<b>Report #18: Pending Data</b>	Dioxin and furan results for samples collected June 10 were not reported.	Dioxins and furans results were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in mid July. This item remains open.
<b>Report #19: Pending Data</b>	Methyl mercury, dioxin and furan results for samples collected June 16 and June 22 were not reported.	Available methylmercury results are discussed in Section 3.3 of Report #20. Dioxins and furans results were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in late July. This item remains open.
<b>Report #20: Pending Data</b>	Dioxin and furan results for samples collected June 25 were not reported.	Dioxins and furans results were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in early August. This item remains open.
	Analytical results for samples collected June 26 – 27 were not reported.	Available analytical results for freshwater receiving environment samples collected June 26 – 27 are discussed in Section 3.6 of Report #21. Methylmercury, dioxin and furans results were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in mid August. This item remains open.
<b>Report #21: WWTP Performance Evaluation</b>	Dissolved oxygen is frequently outside the treatment MDO	Dissolved oxygen levels are generally low and outside the MDO for East WWTP influent and effluent, and are also generally low and outside the WQG in the East Sedimentation Pond waters. Similar observations were made in Report #22 and Report #23. This is currently being investigated to identify root cause(s) and potential mitigation(s). This item remains open.
<b>Report #21: Pending Data</b>	Dioxin and furan results for samples collected July 1 were not reported.	Dioxins and furans results were not complete at the time of reporting. Testing of these parameters typically requires up to 4 weeks to complete. The pending results are expected in mid August. This item remains open.
<b>Report #22: Pending Data</b>	Analytical results for samples collected July 9 and July 13 were not reported.	Analytical results for marine receiving environment samples collected July 9 and 13 were not complete at the time of reporting. The pending results will be included in future weekly reports when available. This item remains open.
<b>Report #22: Monitoring Program Evaluation</b>	Site temperature and precipitation data are not available since July 12 due to malfunction of the Woodfibre Weather Station	Ongoing Woodfibre Weather Station outage. It is uncertain when the station will be back to normal operation. In the interim, weather data are obtained from the Main Street Squamish Station. This item remains open.

**Notes:**

Result QA/QC screening includes the evaluation of field and lab QC results, comparison of total and dissolved metal results and review for modified detection limits.

Pending data are outstanding results from monitoring samples reported in the current or previous weekly reports.

Monitoring program evaluation is an assessment of the completeness of the monitoring program compared to PE-111578 requirements.


## 5. Closure

This weekly report is a desktop review by Lorax of the PE-111578 discharge and compliance monitoring program records, reports and results provided by Woodfibre LNG and prime contractor McDermott International and their sub-contractors. The records reviewed and analyzed by Lorax include ALS Environmental laboratory test reports and site reports (from Roe Environmental, LB LNG, McDermott and Woodfibre LNG). Verbal or electronic communications between Lorax, and Roe Environmental, LB LNG, McDermott, and Woodfibre LNG staff are conducted as needed to confirm the information presented in this report.

Regards,

**LORAX ENVIRONMENTAL SERVICES LTD.**

**Holly Pelletier, B.Sc., GIT**  
**Environmental Geoscientist**



**Cheng Kuang, M.Sc., RPBio**  
**Environmental Scientist**



**Patrick Mueller, B.Sc., P.Chem.**  
**Environmental Chemist**



Note: Imagery provided by McDermott International captured prior to June 8th, 2024.

LEGEND	
	Freshwater Monitoring Station
	Clean Water Diversion Discharge Station
	Marine Water Monitoring Station
	Sediment Pond Monitoring Stations (Water Quality)
	Certified Project Area
	Waterbody
	Watercourse
	Non-Contact Diversion Ditch
	Outfall
	Culvert Pipe

DATE SAVED: Jul 26, 2024  
 DRAWN BY: DM  
 REVIEWED: PM  
 VERSION: 1

Coordinate System: NAD 1983 UTM Zone 10N  
 Projection: Transverse Mercator  
 Datum: North American 1983  
 Units: Metre  
 1:6,000

CLIENT:

PROJECT:

### Woodfibre LNG Project Construction Phase

TITLE:  
 Completed or Under Construction Water Management Facilities and Established PE-111578 Monitoring Stations (July 20, 2024)

PROJECT #: A633-7

FIGURE: 1

## ***Appendix A: East and West Catchment Photographs***

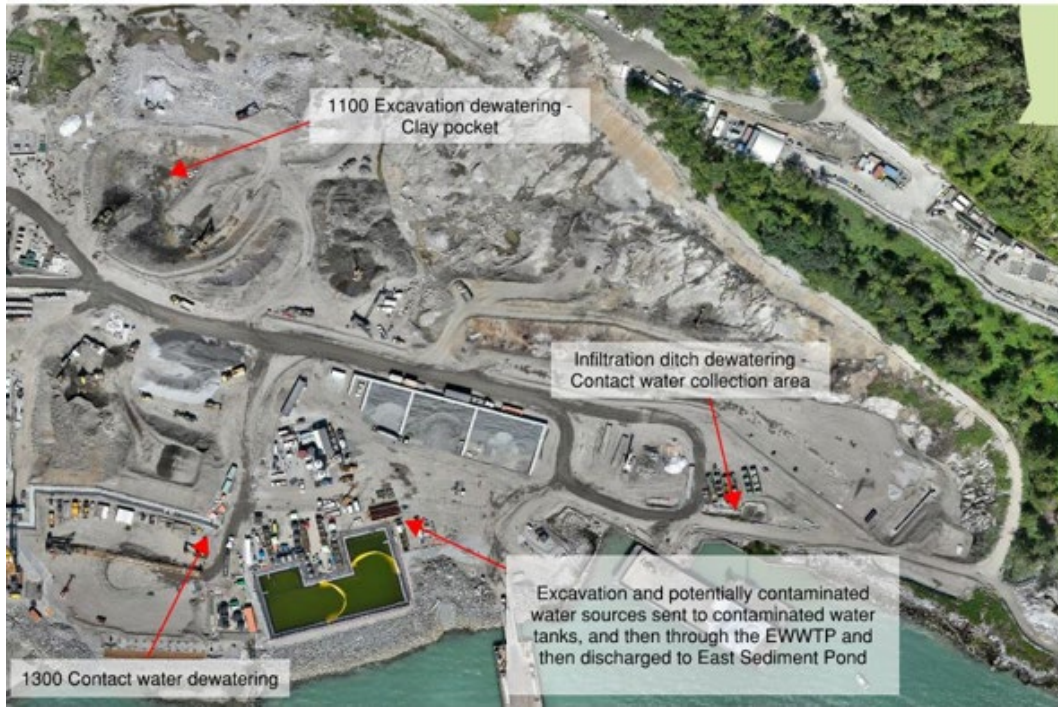


Figure 2: East Catchment Areas Dewatered to the East WWTP July 14 – 20, 2024.



Figure 3: West Catchment Areas Dewatered to the East WWTP July 14 – 20, 2024.



**Figure 4:** Aerial view of the East Sedimentation Pond showing the placement of two sediment curtains (July 19, 2024). The East WWTP is located on the left side of the pond.



**Figure 5:** Aerial view showing the West Sedimentation Pond and West WWTP (located to the right of the pond) on July 19, 2024.



## ***Appendix B: East Sedimentation Pond Results***

**Table B-1:  
Summary of East Sedimentation Pond Water Quality Results Received at the Time of Reporting.**

Parameter	Unit	Lowest Applicable Guideline <sup>1,2</sup>		PE-111578 Discharge Limit <sup>*</sup>	East Sedimentation Pond				
					In-Pond at Effluent Location	In-Pond Location	In-Pond at Effluent Location	In-Pond Location	Effluent
					SP-E-NE	SP-E-NW	SP-E-NE	SP-E-NW	SP-E-OUT
					VA24B6999-001	VA24B6999-004	VA24B7230-001	VA24B7230-004	VA24B7521-001
					2024-07-14 15:00	2024-07-14 16:00	2024-07-16 12:45	2024-07-16 14:00	2024-07-18 15:30
<b>General Parameters</b>									
pH - Field	pH units	- <sup>6</sup>	-	5.5 - 9.0	6.2	6.7	6.2	7.0	6.7
Conductivity - Field	µS/cm	-	-	-	1429	1593	1123	1645	1108
Temperature - Field	°C	-	-	-	26.4	27.9	24.6	29.0	27.7
Salinity - Field	ppt	-	-	-	0.69	0.75	0.56	0.76	0.52
Turbidity - Field	NTU	-	-	-	5.30	5.75	1.84	7.84	3.86
TSS	mg/L	-	-	25	6.1	9.3	<3	10	<3
Dissolved Oxygen - Field	mg/L	≥8	-	-	<u>7.97</u>	8.25	<u>5.81</u>	<u>7.73</u>	<u>4.75</u>
<b>Anions and Nutrients</b>									
Sulphate	mg/L	-	-	-	-	-	37.2	50.9	33.3
Chloride	mg/L	-	-	-	-	-	128	235	86.3
Fluoride	mg/L	-	1.5	-	-	-	0.443	0.29	0.497
Ammonia (N-NH <sub>3</sub> )	mg/L	Variable <sup>3</sup>	Variable <sup>3</sup>	-	-	-	0.0056	<0.005	0.005
Nitrite (N-NO <sub>2</sub> )	mg/L	-	-	-	-	-	<0.005	<0.005	0.0099
Nitrate (N-NO <sub>3</sub> )	mg/L	3.7	339	-	-	-	0.184	<0.025	0.426
<b>Total Metals</b>									
Aluminum, total (T-Al)	mg/L	-	-	-	0.185	0.223	0.0644	0.244	0.0936
Antimony, total (T-Sb)	mg/L	-	0.27 <sup>4</sup>	-	0.00159	0.00169	0.00112	0.00177	0.00078
Arsenic, total (T-As)	mg/L	0.0125	0.0125	-	0.00308	0.00344	0.00236	0.00346	0.0025
Barium, total (T-Ba)	mg/L	-	-	-	0.00693	0.00776	0.00520	0.00932	0.00277
Beryllium, total (T-Be)	mg/L	0.1	-	-	<0.0001	<0.0001	<0.0001	<0.0001	<0.0001
Boron, total (T-B)	mg/L	1.2	-	-	0.146	0.134	0.222	0.135	0.284
Cadmium, total (T-Cd)	mg/L	0.00012	-	-	<0.000025	<0.00002	<0.00001	0.0000226	<0.000025
Chromium, total (T-Cr)	mg/L	-	-	-	0.00051	0.00057	<0.0005	0.00061	<0.0005
Cobalt, total (T-Co)	mg/L	-	-	-	<0.0001	<0.0001	<0.0001	0.0001	<0.0001
Copper, total (T-Cu)	mg/L	- <sup>6</sup>	- <sup>6</sup>	0.0043	0.00160	0.00181	0.00098	0.00217	0.00245
Iron, total (T-Fe)	mg/L	-	-	-	0.052	0.082	0.014	0.141	0.023
Lead, total (T-Pb)	mg/L	- <sup>6</sup>	- <sup>6</sup>	0.0035	0.000301	0.000354	0.000083	0.000688	0.000714
Manganese, total (T-Mn)	mg/L	-	-	-	0.00416	0.00318	0.00106	0.00503	0.00145
Mercury, total (T-Hg) <sup>5</sup>	mg/L	0.000016	-	-	<0.000005	<0.000005	<0.000005	<0.000005	<0.000005
Molybdenum, total (T-Mo)	mg/L	-	-	-	0.0548	0.0499	0.0690	0.0505	0.0835
Nickel, total (T-Ni)	mg/L	0.0083	-	-	<0.0005	<0.0005	<0.0005	0.00055	<0.0005
Selenium, total (T-Se)	mg/L	0.002	-	-	0.000144	0.000157	0.000132	0.000156	0.000099
Silver, total (T-Ag)	mg/L	0.0015	0.003	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Thallium, total (T-Tl)	mg/L	-	-	-	0.000021	0.000022	0.000017	0.000022	0.000012
Uranium, total (T-U)	mg/L	-	-	-	0.0491	0.045	0.0637	0.0438	0.0645
Vanadium, total (T-V)	mg/L	- <sup>6</sup>	-	0.0081	0.00677	0.00772	0.00491	0.00744	0.00594
Zinc, total (T-Zn)	mg/L	- <sup>6</sup>	- <sup>6</sup>	0.0133	0.0051	0.0040	0.0041	0.0060	0.0099
Hexavalent Chromium, total	mg/L	0.0015	-	-	0.00058	<0.0005	<0.0005	<0.0005	<0.0005
<b>Dissolved Metals</b>									
Cadmium, dissolved (D-Cd)	mg/L	-	-	-	<0.000015	<0.000015	<0.00001	0.000013	<0.00003
Copper, dissolved (D-Cu)	mg/L	-	-	-	0.00128	0.00124	0.00087	0.00163	0.00198
Iron, dissolved (D-Fe)	mg/L	-	-	-	<0.01	<0.01	0.011	0.010	0.012
Lead, dissolved (D-Pb)	mg/L	-	-	-	<0.00005	0.000054	<0.00005	0.00005	0.000724
Manganese, dissolved (D-Mn)	mg/L	-	-	-	0.00293	0.00105	0.00088	0.00231	0.00114
Strontium, dissolved (D-Sr)	mg/L	-	-	-	0.142	0.159	0.141	0.159	0.0633
Vanadium, dissolved (D-V)	mg/L	-	-	-	0.00625	0.00715	0.00457	0.00631	0.00577
Zinc, dissolved (D-Zn)	mg/L	-	-	-	0.0024	0.0015	0.0037	0.0036	0.0144
<b>Polycyclic Aromatic Hydrocarbons (PAHs)</b>									
Acenaphthene	mg/L	0.006	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Acridine	mg/L	-	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Anthracene	mg/L	-	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Benz(a)anthracene	mg/L	-	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Benzo(a)pyrene	mg/L	0.00001	-	-	<0.000005	<0.000005	<0.000005	<0.000005	<0.000005
Chrysene	mg/L	0.0001	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Fluoranthene	mg/L	-	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Fluorene	mg/L	0.012	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
1-methylnaphthalene	mg/L	0.001	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
2-methylnaphthalene	mg/L	0.001	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Naphthalene	mg/L	0.001	-	-	<0.00005	<0.00005	<0.00005	<0.00005	<0.00005
Phenanthrene	mg/L	-	-	-	<0.00002	<0.00002	<0.00002	<0.00002	<0.00002
Pyrene	mg/L	-	-	-	<0.00001	<0.00001	<0.00001	<0.00001	<0.00001
Quinoline	mg/L	-	-	-	<0.00005	<0.00005	<0.00005	<0.00005	<0.00005
<b>Volatile Organic Compounds (VOCs)</b>									
Benzene	mg/L	0.11	-	-	-	-	<0.0005	<0.0005	<0.0005
Ethylbenzene	mg/L	0.25	-	-	-	-	<0.0005	<0.0005	<0.0005
Methyl-tert-butyl-ether	mg/L	5	0.44	-	-	-	<0.0005	<0.0005	<0.0005
Styrene	mg/L	-	-	-	-	-	<0.0005	<0.0005	<0.0005
Toluene	mg/L	0.215	-	-	-	-	<0.0004	<0.0004	<0.0004
Total Xylenes	mg/L	-	-	-	-	-	<0.0005	<0.0005	<0.0005
Chlorobenzene	mg/L	0.025	-	-	-	-	<0.0005	<0.0005	<0.0005
1,2-Dichlorobenzene	mg/L	0.042	-	-	-	-	<0.0005	<0.0005	<0.0005

**Notes:**

Results **underlined in bold italics** exceed the applicable long-term water quality guideline for the protection of marine water aquatic life.

Shaded results exceed the applicable short-term water quality guideline for the protection of marine water aquatic life.

Results in **orange** text exceeded the PE11578 East Sedimentation Pond Discharge Limit.

\* The PE11578 East Sedimentation Pond Discharge Limit applies only to the point of discharge from the East Sedimentation Pond (SP-E-Out).

<sup>1</sup> Approved British Columbia Water Quality Guidelines for the protection of marine aquatic life (BC ENV, 2021). Where an approved guideline is not established, the working guideline is applied.

<sup>2</sup> Canadian Water Quality Guideline for the protection of marine aquatic life (CCME, 2021).

<sup>3</sup> The approved total ammonia nitrogen BC WQG is salinity, pH and temperature dependent; see Tables 26E and 26F in BC WQG guidance document (BC ENV, 2021).

<sup>4</sup> The working BC WQG for trivalent antimony [SB(III)] is 0.27 mg/L and is applied to total antimony results.

<sup>5</sup> When MeHg ≤ 0.5% of total Hg, BC WQG = 0.00002 mg/L. The Canadian WQG = 0.000016 mg/L.

<sup>6</sup> Where discharge limits apply, the water quality guideline was not evaluated.

The lowest applicable guidelines are shown in the table; however, water quality data was screened to all applicable guidelines.

**Table B-2:  
Summary of East Sedimentation Pond Daily Field Parameters Received at the Time of Reporting.**

Parameter	Temperature	DO	Salinity	Turbidity	pH	Conductivity	Visibility of Sheen	Total Daily Discharge from the East Sedimentation Pond to Howe Sound	
Unit	°C	mg/L	ppt	NTU	s.u.	µS/cm		m <sup>3</sup>	
<b>PE-111578 Discharge Limit</b> <sup>1</sup>	-	-	-	-	5.5 - 9.0	-	-	.2	
<b>Lowest Applicable Guideline</b> <sup>3,4</sup>	-	≥8	-	-	.5	-	-	-	
<b>Station ID</b> <sup>6</sup>	<b>Date</b>								
SP-E-NE	2024-07-14 15:02	26.4	<b><u>7.97</u></b>	0.69	5.3	6.2	1429	No	0
SP-E-NW	2024-07-14 15:57	27.9	8.25	0.75	5.75	6.7	1593	No	
SP-E-NE	2024-07-15 13:39	26.0	<b><u>7.16</u></b>	0.65	1.76	6.3	1327	No	0
SP-E-NE	2024-07-16 12:36	24.6	<b><u>5.81</u></b>	0.56	1.84	6.2	1123	No	0
SP-E-NW	2024-07-16 13:55	29.0	<b><u>7.73</u></b>	0.76	7.84	7.0	1645	No	
SP-E-NE	2024-07-17 14:55	26.9	<b><u>5.83</u></b>	0.53	3.15	6.3	1110	No	0
SP-E-NE	2024-07-18 11:03	25.2	<b><u>5.04</u></b>	0.53	0.58	6.4	1074	No	428
SP-E-OUT	2024-07-18 15:57	27.7	<b><u>4.75</u></b>	0.52	3.86	6.7	1108	No	
SP-E-NE	2024-07-19 15:31	26.8	-- <sup>7</sup>	0.69	5.93	6.8	1437	No	1227
SP-E-OUT	2024-07-19 16:52	27.3	<b><u>6.48</u></b>	0.64	6.51	7.0	1354	No	
SP-E-NE <sup>8</sup>	2024-07-20 14:04	26.8	<b><u>7.08</u></b>	0.65	3.39	6.5	1360	No	345

**Notes:**

Results **underlined in bold italics** exceed the applicable long-term water quality guideline for the protection of marine water aquatic life.

Results in **orange** text exceeded the PE- 11578 East Sedimentation Pond Discharge Limit.

<sup>1</sup> PE-111578 East Sedimentation Pond Discharge Limit applies only to the point of discharge from the East Sedimentation Pond (SP-E-OUT).

<sup>2</sup> The annual average authorized discharge rate from the East Sedimentation Pond is 650 m<sup>3</sup>/day. As noted in PE-111578 Condition 2.1.4, the actual discharge rate may deviate from the annual average rate due to annual variations in precipitation amounts within the catchment area. Therefore, the annual average authorized discharge rate is not evaluated as a discharge limit.

<sup>3</sup> Approved British Columbia Water Quality Guidelines for the protection of marine aquatic life (BC ENV, 2021). Where an approved guideline is not established, the working guideline is applied.

<sup>4</sup> Canadian Water Quality Guideline for the protection of marine aquatic life (CCME, 2021).

<sup>5</sup> Discharge limit applies therefore the water quality guideline was not evaluated.

<sup>6</sup> The sedimentation pond did not receive non-contaminated contact water influent July 14 – July 20, therefore daily measurements for station SP-E-IN-2 were not collected. In-Pond stations SP-E-NW and SP-E-NE may be monitored in place of stations SP-E-IN-2 and SP-E-OUT, respectively when there is no influent to, or discharge from the East Sedimentation Pond at the time of monitoring.

<sup>7</sup> The July 19 field DO measurement at station SP-E-NE is an erroneous reading and is therefore not reported.

<sup>8</sup> Field parameters were not collected at the effluent station SP-E-OUT on July 20 as the pond was not discharging at the time of monitoring, therefore field measurements were collected at SP-E-NE.

## ***Appendix C: East Wastewater Treatment Plant Results***

**Table C-1:  
Summary of East Wastewater Treatment Plant Water Quality Results Received at the Time of Reporting.**

Parameter	Unit	Minimum Discharge Objective <sup>1</sup>	East WWTP			
			Influent	Effluent	Influent	Effluent
			WWTP-E-IN	WWTP-E-OUT	WWTP-E-IN	WWTP-E-OUT
			VA24B6999-003 2024-07-14 15:15	VA24B6999-002 2024-07-14 15:30	VA24B7230-003 2024-07-16 13:15	VA24B7230-002 2024-07-16 13:45
<b>General Parameters</b>						
pH - Field	pH units	7.0 - 8.7	<u>6.7</u>	<u>5.8</u>	<u>6.7</u>	<u>6.1</u>
Conductivity - Field	µS/cm	-	719	1194	1141	1131
Temperature - Field	°C	-	26.8	25.8	26.1	25.7
Salinity - Field	ppt	-	0.34	0.58	0.55	0.55
Turbidity - Field	NTU	-	4.63	2.53	4.38	0.34
TSS	mg/L	-	7.7	5.1	<3	<3
Dissolved Oxygen - Field	mg/L	>=8	<u>6.35</u>	<u>3.41</u>	<u>5.53</u>	<u>4.30</u>
<b>Anions and Nutrients</b>						
Sulphate	mg/L	-	-	-	38.2	35.9
Chloride	mg/L	-	-	-	130	115
Fluoride	mg/L	-	-	-	0.432	0.462
Ammonia (N-NH <sub>3</sub> )	mg/L	Variable	-	-	<0.005	0.0154
Nitrite (N-NO <sub>2</sub> )	mg/L	-	-	-	0.0061	<0.005
Nitrate (N-NO <sub>3</sub> )	mg/L	3.7	-	-	0.177	0.354
<b>Total Metals</b>						
Aluminum, total (T-Al)	mg/L	-	0.180	0.0931	0.0625	0.0531
Antimony, total (T-Sb)	mg/L	-	0.00156	0.00135	0.00112	0.00102
Arsenic, total (T-As)	mg/L	0.0125	0.00317	0.00294	0.00243	0.00283
Barium, total (T-Ba)	mg/L	-	0.00670	0.00555	0.00545	0.00486
Beryllium, total (T-Be)	mg/L	0.1	<0.0001	<0.0001	<0.0001	<0.0001
Boron, total (T-B)	mg/L	1.2	0.157	0.192	0.223	0.229
Cadmium, total (T-Cd)	mg/L	0.00012	<0.000025	<0.000015	<0.00001	<0.000005
Chromium, total (T-Cr)	mg/L	-	0.00053	<0.0005	<0.0005	<0.0005
Cobalt, total (T-Co)	mg/L	-	<0.0001	<0.0001	<0.0001	<0.0001
Copper, total (T-Cu)	mg/L	0.002	<u>0.00301</u>	0.00129	<u>0.00258</u>	0.00186
Iron, total (T-Fe)	mg/L	-	0.058	0.022	0.02	<0.01
Lead, total (T-Pb)	mg/L	0.002	0.000351	0.000168	0.000119	<0.00005
Manganese, total (T-Mn)	mg/L	-	0.00360	0.00328	0.00114	0.00021
Mercury, total (T-Hg)	mg/L	0.000016	<0.000005	<0.000005	<0.000005	<0.000005
Molybdenum, total (T-Mo)	mg/L	-	0.0554	0.0627	0.0678	0.0736
Nickel, total (T-Ni)	mg/L	0.0083	<0.0005	<0.0005	<0.0005	<0.0005
Selenium, total (T-Se)	mg/L	0.002	0.000160	0.000127	0.000138	0.000131
Silver, total (T-Ag)	mg/L	0.0015	<0.00001	<0.00001	<0.00001	<0.00001
Thallium, total (T-Tl)	mg/L	-	0.000019	0.000018	0.000018	0.000015
Uranium, total (T-U)	mg/L	-	0.0503	0.0608	0.0634	0.0666
Vanadium, total (T-V)	mg/L	0.005	<u>0.00661</u>	<u>0.00582</u>	0.00494	<u>0.00583</u>
Zinc, total (T-Zn)	mg/L	0.01	<u>0.0138</u>	0.00470	<u>0.0103</u>	<0.003
Hexavalent Chromium, total	mg/L	0.0015	<0.0005	<0.0005	<0.0005	<0.0005
<b>Dissolved Metals</b>						
Cadmium, dissolved (D-Cd)	mg/L	-	<0.00002	<0.000015	<0.00001	<0.00001
Copper, dissolved (D-Cu)	mg/L	-	0.00145	0.00110	0.00129	0.00104
Iron, dissolved (D-Fe)	mg/L	-	<0.01	<0.01	0.01	<0.01
Lead, dissolved (D-Pb)	mg/L	-	<0.00005	<0.00005	<0.00005	<0.00005
Manganese, dissolved (D-Mn)	mg/L	-	0.00131	0.00070	0.00091	0.0001
Strontium, dissolved (D-Sr)	mg/L	-	0.145	0.162	0.144	0.12
Vanadium, dissolved (D-V)	mg/L	-	0.00635	0.00543	0.00445	0.00519
Zinc, dissolved (D-Zn)	mg/L	-	0.0061	<0.001	0.014	<0.001
<b>Polycyclic Aromatic Hydrocarbons (PAHs)</b>						
Acenaphthene	mg/L	0.006	<0.00001	<0.00001	<0.00001	<0.00001
Acridine	mg/L	-	<0.00001	<0.00001	<0.00001	<0.00001
Anthracene	mg/L	-	<0.00001	<0.00001	<0.00001	<0.00001
Benz(a)anthracene	mg/L	-	<0.00001	<0.00001	<0.00001	<0.00001
Benzo(a)pyrene	mg/L	0.00001	<0.000005	<0.000005	<0.000005	<0.000005
Chrysene	mg/L	0.0001	<0.00001	<0.00001	<0.00001	<0.00001
Fluoranthene	mg/L	-	<0.00001	<0.00001	<0.00001	<0.00001
Fluorene	mg/L	0.012	<0.00001	<0.00001	<0.00001	<0.00001
1-methylnaphthalene	mg/L	0.001	<0.00001	<0.00001	<0.00001	<0.00001
2-methylnaphthalene	mg/L	0.001	<0.00001	<0.00001	<0.00001	<0.00001
Naphthalene	mg/L	0.001	<0.00005	<0.00005	<0.00005	<0.00005
Phenanthrene	mg/L	-	<0.00002	<0.00002	<0.00002	<0.00002
Pyrene	mg/L	-	<0.00001	<0.00001	<0.00001	<0.00001
Quinoline	mg/L	-	<0.00005	<0.00005	<0.00005	<0.00005
<b>Volatile Organic Compounds (VOCs)</b>						
Benzene	mg/L	0.11	-	-	<0.0005	<0.0005
Ethylbenzene	mg/L	0.25	-	-	<0.0005	<0.0005
Methyl-tert-butyl-ether	mg/L	5	-	-	<0.0005	<0.0005
Styrene	mg/L	-	-	-	<0.0005	<0.0005
Toluene	mg/L	0.215	-	-	<0.0004	<0.0004
Total Xylenes	mg/L	-	-	-	<0.0005	<0.0005
Chlorobenzene	mg/L	0.025	-	-	<0.0005	<0.0005
1,2-Dichlorobenzene	mg/L	0.042	-	-	<0.0005	<0.0005

**Notes:**

<sup>1</sup> Minimum discharge objective for the WWTP effluent.  
Results underlined in bold italics exceed the applicable minimum discharge objective.

**Table C-2:  
Summary of East Wastewater Treatment Plant Daily Field Parameters Received at the Time of Reporting.**

Parameter	Temperature	DO	Salinity	Turbidity	pH	Conductivity	Visibility of Sheen	Total Daily Discharge from the East WWTP	
Unit	°C	mg/L	ppt	NTU	s.u.	µS/cm		m <sup>3</sup>	
<b>PE-111578 Discharge Limit <sup>1</sup></b>	-	-	-	-	-	-	-	1,100	
<b>Minimum Discharge Objective <sup>2</sup></b>	-	≥8	-	-	7.0 - 8.7	-	-	-	
Station ID	Date								
WWTP-E-IN	2024-07-14 15:24	26.8	<b><u>6.35</u></b>	0.34	4.63	<b><u>6.7</u></b>	719	No	-
WWTP-E-OUT	2024-07-14 15:38	25.8	<b><u>3.41</u></b>	0.58	2.53	<b><u>5.8</u></b>	1194	No	625
WWTP-E-IN	2024-07-15 13:43	26.4	<b><u>7.45</u></b>	0.64	2.89	<b><u>6.6</u></b>	1331	No	-
WWTP-E-OUT	2024-07-15 13:31	25.1	<b><u>4.83</u></b>	0.57	0.56	<b><u>6.0</u></b>	1156	No	599
WWTP-E-IN	2024-07-16 13:03	26.1	<b><u>5.53</u></b>	0.55	4.38	<b><u>6.7</u></b>	1141	No	-
WWTP-E-OUT	2024-07-16 13:27	25.7	<b><u>4.30</u></b>	0.55	0.34	<b><u>6.1</u></b>	1131	No	576
WWTP-E-IN	2024-07-17 14:59	27.2	<b><u>5.59</u></b>	0.52	4.52	<b><u>6.7</u></b>	1101	No	-
WWTP-E-OUT	2024-07-17 15:02	26.5	<b><u>5.24</u></b>	0.52	4.52	<b><u>6.2</u></b>	1081	No	570
WWTP-E-IN	2024-07-18 11:07	25.9	<b><u>5.68</u></b>	0.51	0.72	<b><u>6.8</u></b>	1049	No	-
WWTP-E-OUT	2024-07-18 11:13	25.4	<b><u>5.20</u></b>	0.52	0.00	<b><u>6.4</u></b>	1056	No	563
WWTP-E-IN	2024-07-19 15:35	27.6	<b><u>6.72</u></b>	0.67	6.38	7.2	1420	No	-
WWTP-E-OUT	2024-07-19 15:40	24.9	<b><u>5.43</u></b>	0.46	4.91	<b><u>6.1</u></b>	933	No	569
WWTP-E-IN	2024-07-20 14:06	26.9	<b><u>6.42</u></b>	0.66	3.48	<b><u>6.8</u></b>	1370	No	-
WWTP-E-OUT	2024-07-20 14:01	25.8	<b><u>6.30</u></b>	0.65	3.21	<b><u>6.1</u></b>	1329	No	536

**Notes:**

<sup>1</sup> PE-111578 East WWTP Discharge Limit is applied to effluent compliance station WWTP-E-OUT.

<sup>2</sup> Minimum discharge objective for the WWTP effluent.

Results **underlined in bold italics** exceed the applicable minimum discharge objective.